



REPORT NUMBER: 140829003SHJ-BP-1R2
ORIGINAL ISSUE DATE: September 15, 2014
REVISED DATE: December 16, 2014

EVALUATION CENTER

Intertek Testing Services Ltd., Shanghai
Plant 7, No. 6958 Daye Road, Fengxian District,
Shanghai, China 201405

RENDERED TO

Watermark International Pty, Ltd.
9a, Davis Road, Wetherill Park, NSW 2164, Australia

Report of Testing “Nu-core®FR Plus, Model of 3mm FR core, 0.5mm front skin(Aluminium),0.5 back skin(Aluminium)” for compliance with the applicable requirements of the following criteria: ASTM E84-14 Standard Test Method for Surface Burning Characteristics of Building Materials (UL 723, UBC 8-1, NFPA 255)

TEST REPORT

ABSTRACT

Specimen I. D.	“Nu-core®FR Plus, Model of 3mm FR core, 0.5mm front skin(Aluminium),0.5 back skin(Aluminium)”	
Test Standard:	ASTM E84-14 Standard Test Method for Surface Burning Characteristics of Building Materials (UL 723, UBC 8-1, NFPA 255)	
Test Date:	September 11, 2014	
Client:	Watermark International Pty, Ltd.	
Test Results:	FLAME SPREAD INDEX	0
	SMOKE DEVELOPED INDEX	0

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of the report. Only the Client is authorized to copy or distribute this report and then only in its entirety. Any use of Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

Reported by: Timothy Li
Timothy Li
Testing Engineer, Building Products

Checked by: Harrison Li
Harrison Li
Senior Project Engineer, Building Products

Reviewed by: Sun Sun
Sun Sun
Assistant Manager, Building Products



I. INTRODUCTION

This report describes the results of the ASTM E84-14 Standard Test Method for Surface Burning Characteristics of Building Materials a method for determining the comparative surface burning behavior of building materials. This test is applicable to exposed surfaces, such as ceilings or walls, provided that the material or assembly of materials, by its own structural quality or the manner in which it is tested and intended for use, is capable of supporting itself in position or being supported during the test period.

The purpose of the method is to determine the relative burning behavior of the material by observing the flame spread along the specimen. Flame spread and smoke density developed are reported, however, there is not necessarily a relationship between these two measurements.

“The use of supporting materials on the underside of the test specimen may lower the flame spread index from that which might be obtained if the specimen could be tested without such support... This method may not be appropriate for obtaining comparative surface burning behavior of some cellular plastic materials... Testing of materials that melt, drip, or delaminate to such a degree that the continuity of the flame front is destroyed, results in low flame spread indices that do not relate directly to indices obtained by testing materials that remain in place.”

This test method is also published under the following designations:

NFPA 255
UL 723
UBC 8-1

This standard should be used to measure and describe the properties of materials, products, or assemblies in response to heat and flame under controlled laboratory conditions and should not be used to describe or appraise the fire hazard or fire risk of materials, products, or assemblies under actual fire conditions. However, results of this test may be used as elements of a fire risk assessment which takes into account all of the factors which are pertinent to an assessment of the fire hazard of a particular end use.



II. PURPOSE

The ASTM E84 (25 foot tunnel) test method is intended to compare the surface flame spread and smoke developed measurements to those obtained from tests of fiber cement board and select grade red oak flooring. The test specimen surface (18 inches wide and 24 feet long) is exposed to a flaming fire exposure during the 10 minute test duration, while flame spread over its surface and density of the resulting smoke are measured and recorded. Test results are presented as the computed comparisons to the standard calibration materials.

The furnace is considered under calibration when a 10 minute test of red oak decking will pass flame out the end of the tunnel in five minutes, 30 seconds, plus or minus 15 seconds. The fiber cement board which complies with Annex A3 of the ASTM E 84 standard forms the zero point for both flame spread and smoke developed indexes, while the red oak flooring smoke developed index is set as 100.

III. TEST PROCEDURE

The tests were conducted in accordance with the procedures outlined in the ASTM E84. The specimens are placed directly on the tunnel ledges. As required by the standard, one or more layers of 0.25 inch thick reinforced concrete board are placed on top of the test sample between the sample and the tunnel lid. After the test, the samples are removed from the tunnel, examined and disposed of.

IV. REVISION SUMMARY

DATE	SUMMARY
September 15, 2014	Original
September 19, 2014	Change the sample photo in section V.
December 16, 2014	Change the sample I.D. to "Nu-core®FR Plus"



V. DESCRIPTION OF TEST SPECIMENS

Date Received:	08/29/2014
Date placed in the conditioning room:	13 days
Conditioning (73°F & 50% R.H.):	13 days
Specimen Width (in):	24
Specimen Length (ft):	24
Specimen Thickness (in):	0.16
Total Specimen Weight (lbs):	69.20

Specimen Description:

The specimen was described by the client as “Nu-core®FR Plus”, Model: 3mm FR core; 0.5mm front skin (Aluminium), 0.5mm back skin (Aluminium).

The 24-ft. long test specimen consisted of 8 sections of “Nu-core®FR Plus”, Model: 3mm FR core; 0.5mm front skin (Aluminium), 0.5mm back skin (Aluminium). Section 1 to section 7 was 3.28-ft long by 24-in wide, and section 8 was 1.09-ft long by 24-in wide. Pictures of the specimen as well as a picture of the specimen mounted in the furnace are provided below.

The product was received by our personnel in good condition and given an identification number of S140829003SHJ-001~008.

Mounting Method:

The specimen was self-supporting. The light PVDF side was exposed to the flame.



VI. TEST RESULTS & OBSERVATIONS

The test results, computed on the basis of observed flame front advance and electronic smoke density measurements are presented in the following table.

Test Specimen	Flame Spread Index	Smoke Developed Index
“Nu-core®FR Plus, Model of 3mm FR core, 0.5mm front skin(Aluminium), 0.5 back skin(Aluminium)”	0	0

The data sheets are included in Appendix A. These sheets are actual print-outs of the computerized data system which monitors the tunnel furnace, and contain all calibration and specimen data needed to calculate the test results.

VII. OBSERVATIONS

During the test, the specimen was observed to behave in the following manner.

Time (min:sec)	Observations
0:00	The test burners were turned on.
4:20	Sagging was observed.
10:00	The test burners were shut off.

After the burners were turned off, no after flame was observed.

After the test, the specimen was observed to be damaged as follows:

Distance (FEET)	Damage Descriptions
0 - 6	The specimen was discolored.
6 - 24	The specimen was lightly discolored.



APPENDIX A

ASTM E84 DATA SHEETS



Test Method Lab ID Project #
ASTM E84 Intertek Fire Laboratory 140829003

Date
11 Sep 2014 Time (Test Start) 2:06 PM Test No. 1

Specimen ID
4mm ACP




Specimen Description
4mm ACP, 3mm FR core, 0.5mm front skin(Aluminium),0.5mm back skin(Aluminium)

Mounting Procedure
Self-supporting

Fuel (CF) 43.1 RO Smk Area 59.1 Smoke Area (%A min) -6.0

FS Area (ft-min) 0.80 Maximum FS 0.10

MAX FS Time (min) 1.91 Max Temp 568.8

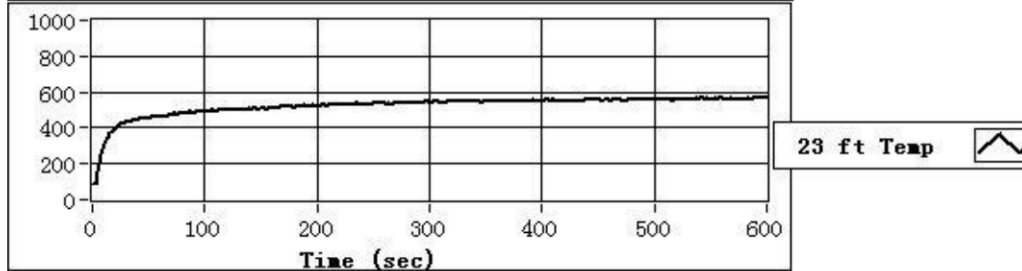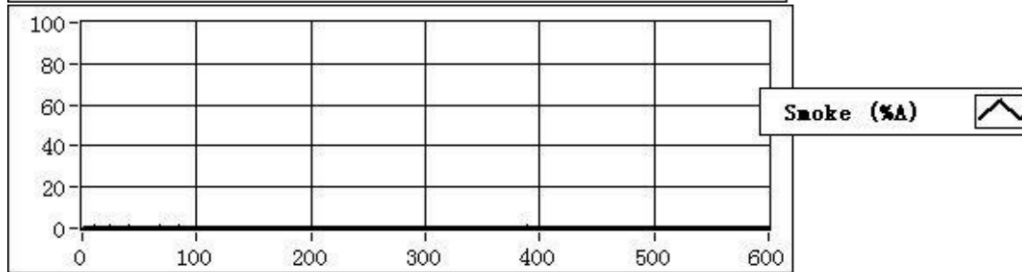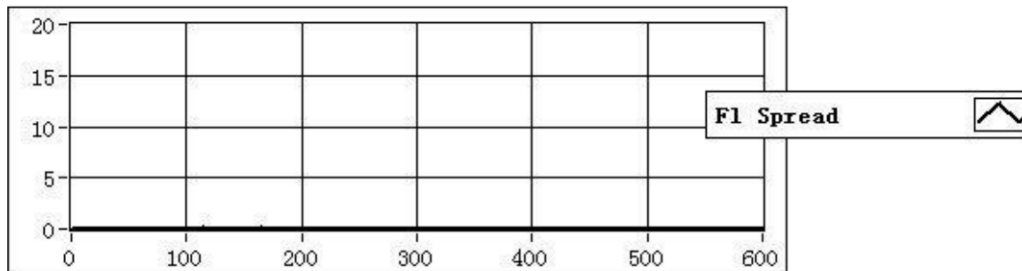

Raw SD -10.2 Final FSI 0 Final SD 0

Time to 980F (min) 0.00

